

# Johnson County Special Utility District

## *Annual Water Quality - Consumer Confidence Report 2019*

This report published in 2020 is intended to provide you with information about your drinking water and the District's efforts to provide safe drinking water. The latest test results data, Jan-Dec 2019, is used for this publication. Providing water / wastewater services to over 18,000 connections, JCSUD's service area covers the majority of rural Johnson County and some of Tarrant and Hill counties.

### *Mission Statement*

*The Board of Directors and staff are united in providing quality drinking water with quality service, to plan best to accommodate growth, and apply the fairest, reasonable cost all while conserving resources.*



by Pete Kampfer, GM

Access CCR online at  
<https://jesud.com/ccr1>

### *Today at Johnson County Special Utility District,*

The JCSUD staff takes pride in striving to uphold the District's mission statement. This message serves to instill favor and confidence in the daily work we do. Moreover, please remember those directors that represent you as they volunteer their time to serve on the Board of Directors. It is the Board's good actions which advocates management's practice to implement timely projects and programs. Good leadership here at JCSUD takes stewardship seriously to apply what is best for the good of the whole. Listed below are only a few of the most recent projects undertaken by the JCSUD Board Directors:

#### *TWDB Loan – Bundled CIP Line Extension Projects*

In terms of distribution system projects taken on in a consolidated, relatively short interval, this TWDB loan project represents the largest undertaking for the District in its 54-year history. About \$17 million of this project goes toward the construction of distribution system improvements, while about \$5.2 million goes toward the AMI (Advanced Metering Infrastructure) system project (smart-meter replacement). JCSUD's reserves are ample to cover the remainder, which is designated for soft cost including engineering, project management, etc. Roughly half of this undertaking is dedicated towards replacing smaller lines and some system maintenance. The other half is committed to addressing new growth and related distribution improvements. Completion expected in 2021.

#### *AMI and Smart-meter conversion*

Deployment of this project began in 2019. AMI is rapidly the up and coming new standard among public water systems and other utilities around the country for the same good reasons. AMI platforms from a specialized data management software system which integrates with new "smart meters". Converting JCSUD over to the AMI system will enhance

customer service and improve the overall efficiency in the meter reading and billing process. To date the project is about 80% complete. Final completion is expected to be summer 2020.

#### *Community Development Grant Project*

This waterline extension project is 6-inch pipe for 11,260 feet. The District submitted for this grant application in February 2017. The grant consultant indicates that JCSUD qualifies for funding, but the final confirmation is not yet complete. This \$275,000 grant through the Community Development Block program is administered by the Texas Department of Agriculture as federal HUD dollars are distributed throughout the states. The grant calls for JCSUD to participate with fractional matching funds depending on total construction cost. Estimated completion is late 2020.

#### *Water/Wastewater Master Plan Update*

Since the District's last Master Plan update in 2014, the District has implemented more water system improvements in such a short interval than ever before at \$24 million. The water system Master Plan was updated to best plan for capital projects need in 5-year increments for the next 15 years. Changes in growth patterns and growth rates impact the timing of implementing projects. Likewise, the District maintains a sewer system Master Plan for the Joshua area of the system. Some \$2 million has been spent making sewer system improvements since 2013. Master planning enables the District to plan best for needed collection system improvements and evaluate the timing of treatment plant improvements for better efficiency and accommodating growth. Completion estimated this year.

We hope you find this 2019 Consumer Confidence Report to be helpful for your consumer needs.

## REGULATED SUBSTANCES

Substance	Unit of Measure	Year	Highest Level Detected	Individual samples range	MCL	MCLG	Typical Source
Barium	ppm	2019	0.043	0.06-0.043	2	2	Discharge of drilling wastes; discharge from metal refineries; erosion of natural deposits.
Fluoride	ppm	2017	2.44	0.31 – 2.44	4	4	Erosion of natural deposits; water additive which at low levels promotes strong teeth; discharge from fertilizer and aluminum factories.
Nitrate	ppm	2019	1.91	0.031-1.91	10	10	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits.
Chromium	ppb	2019	.0017	.0012 – .0017	.1	.1	Discharge from steel and pulp mills; Erosion of natural deposits.
Combined Radium 226/228	pCi/L	2017	1.5	1.5 – 1.5	5	0	Erosion of natural deposits
Xylenes	ppm	2019	0.0005	0 – 0.0005	1	1	Discharge from petroleum and chemical factories.

### Disinfectant Residual

Disinfectant	Unit of Measure	Year	Average Level	Range of Levels	MRDL	MRDLG	Typical Source
Chloramines Free Chlorine	ppm	2019	2.52	0.70 – 3.96	4.0	<4.0	Water additive used to control microbes

### Disinfection Byproducts *The values in the Highest Average column is the highest average of all sample results collected over a year.*

Substance	Unit of Measure	Year	Highest Average	Individual Samples Range	MCL	Typical Source
Haloacetic Acids HAA5	ppb	2019	29.50	1.00 – 29.50	60	By-products of drinking water disinfection
Total Trihalomethanes TTHM	ppb	2019	40.00	4.6 – 40.00	80	

*Turbidity is a measure of the clarity of the water. We monitor it because it is a good indicator of the effectiveness of our filtration system. During the reporting year, samples taken to measure turbidity met water quality standards.*

Substance	Unit of Measure	Year	Highest Single Measurement	Lowest Monthly % of Samples Meeting Limits	Turbidity Limits	MCL	Typical Source
Turbidity	NTU	2019	.35	100%	0.3	TT	Soil Runoff

### Additional Health Information for Lead:

If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in drinking water is primarily from materials and components associated with service lines and home plumbing. This water supply is responsible for providing high quality drinking water but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps to take to minimize exposure is available from the Safe Drinking Water Hotline at (800) 426-4791 or at <http://www.epa.gov/safewater/lead>.

*Tap water samples were collected for lead and copper analyses from homes throughout the service area.*

Lead and Copper	Unit of Measure	Sampled	The 90th Percentile	No. of Sites Above AL	Action Level	Typical Source
Copper	ppm	2018	0.19	0	1.3	Corrosion of household plumbing systems; Erosion of natural deposits. Leaching from wood preservatives.
Lead	ppb	2018	3.4	0	15	Corrosion of household plumbing systems; Erosion of natural deposits.

*Action Level: The concentration of a contaminant which, if exceeded, triggers treatment or other requirements which a water system must follow.*

Public water suppliers are required to submit their annual Water Loss Audit report to the Texas Water Development Board. Every water system has water loss and commit to reporting to its customers the percentage of unmetered water from the total supply which is pumped annually. It can range up to 50% for some. Over the last few years JCSUD's water loss ranges from 15 to 18%. For 2019, JCSUD accounts for 16.5% total water loss or 288 MG (million gal) of the 1746 MG that was pumped into the system.

There are two categories of water loss called Apparent Losses and Real Losses. Real Losses include the weeps and seeps which go undetected among the 879 miles of water mains throughout the distribution system. Apparent Losses are mainly due to meter inaccuracy. Over time, mechanical meters tend to "under register" the actual amount which flows through them. In turn this generates water loss and accounts for about 15% of the total system losses.

According to EPA publication about water loss, 16% is on the low end of the average water loss value for public water systems. Nevertheless, the District is committed to reducing water loss to adopt a Water Loss Control Program. A water loss control program consists of three major steps. The critical first step is the **water audit**. A water audit identifies and quantifies the water uses and losses from a water system. The **intervention process** addresses the findings of the water audit through implementation of controls to reduce or eliminate water losses. The **evaluation step** uses performance indicators to determine the success of the chosen intervention actions. Utilizing the standard terminology and the three steps of a water loss control program, systems can determine their baseline water use and loss, prioritize and implement water efficiency projects and operational changes, and evaluate and continuously improve water loss Water Audit Evaluation Intervention.

## Under the Microscope

We are pleased to report that during the past year, the water delivered to your home or business complies with all state and federal drinking water requirements. The tables on page 2 show what substances were detected in our drinking water during the last testing period. Although all the substances listed are under the Maximum Contaminant Level (MCL) set by the U.S. Environmental Protection Agency (EPA), it is important to inform of what was detected and how much of the substance was present in the water. The state requires monitoring for certain substances less than once per year because the concentrations of these substances do not change frequently. Contaminants that may naturally exist in untreated water include organic biological elements, such as bacteria and viruses; inorganics, such as salts and metals; pesticides and herbicides; chemicals from industrial or petroleum use; and radioactive materials. Fortunately, the report shows that contaminants do not exist in our local sources at action levels.

Many substances (such as calcium, sodium, or iron) which are often found in drinking water, can cause taste, color, and odor concerns. The taste and odor substances are called secondary substances and are regulated by the State of Texas, not the EPA. These substances are not cause for health concerns. Secondaries are not required to be reported in this document, but they may affect the appearance and taste of your water.

### Some Secondary Substances

This chart lists other items for which the water is tested. These items do not relate to public health but rather to aesthetic effects.

These items are often important to industrial users.

**No MCL exists**

Item	Measure	Avg Level
Calcium	ppm	2.19
Iron	ppm	0.05
pH	units	8.55
Sodium	ppm	225.90
Total Hardness	ppm	8.781

## Community Participation

The District is governed by a Board of seven directors. Terms are staggered such that a portion of the Board positions are renewable each election cycle. In accordance with the Texas Election Code, each year the District orders an election which is scheduled for the first Saturday in February. The last day to file for a place on the ballot is 60 days before the Election Day. To learn more about the District's governance and the schedule for the next election planning cycle, please call the office. The Board regularly meets on the third Tuesday of each month beginning at 5:30 pm at the District office. An open forum at the beginning of each meeting is a time to receive public comments or concerns by those who wish to attend. Address: 740 FM 3048, Joshua, TX 76058. Phone: 817-760-5200

En Español:

Este informe incluye información importante sobre el agua para tomar. Para asistencia en español, favor de llamar al telefono (817) 760-5200.

## DEFINITIONS and ABBREVIATIONS

**MCLG:** Maximum Contaminant Level Goal. The level of a contaminant in drinking water which there is no known or expected health risk. MCLGs allow for a margin of safety.

**MCL:** Maximum Contaminant Level. The highest permissible level of a contaminant in drinking water. MCLs are set as close to the MCLGs as feasible using the best available treatment technology.

**MRDL:** Maximum Residual Disinfectant Level. The highest level of disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

**MRDLG:** Maximum Residual Disinfectant Level Goal. The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectant to control microbial contamination.

**Action Level:** The concentration of a contaminant, which if exceeded, triggers treatment or other requirements which a water system must follow.

**TT:** Treatment Technique, a required process to reduce the level of a contaminant in drinking water.

**NTU:** Nephelometric Turbidity Units

**ppm:** parts per million, or milligrams per liter (mg/L) – or one ounce in 7,350 gallons of water

**ppb:** parts per billion, or micrograms per liter (µg/l) – or one ounce in 7,350,000 gallons of water.

**pCi/L:** picocuries per liter (measure of radioactivity)



### Convenient Options for our Customers:

- Go paperless. Receive email notification when bill is ready.
- Sign up to receive and pay bill with text message system.
- Call toll free number 833-529-2837 for automated pay.
- Visit website: <http://www.jcsud.com> to pay your bill online.
- Pay by mail, in person, or night drop.
- We accept Visa, MasterCard, Discover, American Express

## Source Water Assessment

The TCEQ completed an assessment of our source water and results indicate that some of our sources are susceptible to certain contaminants. The sampling requirements for our water system are based on this susceptibility and previous sample data. Any detections of these substances may be found in this Consumer Confidence Report.


The District has two main water production sources. About 30 percent of total production comes from well water (Trinity Aquifer) and 70 percent is from purchased surface water from Lake Granbury and the City of Mansfield.

For more information about our focus on protection efforts, contact Danny Armstrong at 817-760-5200.

All sources are monitored and tested according to state regulations.

## Required Language about Fluoride

This is an alert about drinking water and a cosmetic dental problem that might affect children under the age of nine. At low levels, fluoride can help prevent cavities, but some children drinking water with more than 2 milligrams per liter (mg/L) of fluoride may possibly develop cosmetic discoloration of their permanent teeth (dental fluorosis), which can occur only in developing teeth before they erupt from the gums. Your drinking water does not contain more than 4.0 mg/L of fluoride, which is the maximum contaminate level limit, yet a notice is needed because of a 2.4 mg/L sample reported, as explained here.

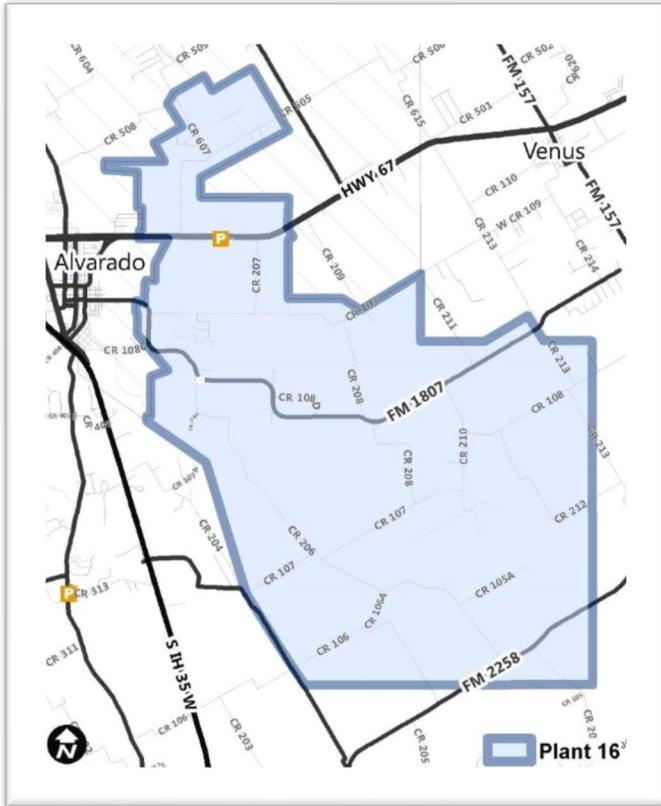

Systems exceeding the fluoride secondary constituent level (SCL) of 2.0 mg/L but has not exceeded the maximum contaminant level (MCL) are required to notify customers in the Consumer Confidence Report. In 2017, one ground water well pump station sample triggered an alert for a specific area. There is a small portion within the distribution system where Trinity and Paluxy wells revealed a fluoride level of 2.4 mg/L. The subject area represents only 5% of the total system connections (some 700 residents) that should be mindful of this notice. The subject area is just east of Alvarado and generally south of U.S. Hwy. 67 around the F.M. 1807 corridor, as shown on the map at left.

For more information, please call Danny Armstrong, System Operations Manager, 817-760-5200.

### *Special Health Information*      *Required language for ALL community public water suppliers:*

You may be more vulnerable than the general population to certain microbial contaminants, such as Cryptosporidium, in drinking water. Infants, some elderly, or immunocompromised persons such as those undergoing chemotherapy; those who have undergone organ transplants; those who are undergoing treatment with steroids; and people with HIV/AIDS or other immune system disorders, can be particularly at risk from infections. You should seek advice about drinking water from your physician or health care provider. Additional guidelines on appropriate means to lessen the risk of infection by Cryptosporidium are available from the EPA's Safe Drinking Water Hotline at 800-426-4791.

### *Some Elements are Expected*

To ensure tap water is safe to drink, the U.S. EPA prescribes regulations limiting the amount of certain elements in water provided by public water systems. U.S. Food and Drug Administration regulations establish limits for contaminants in bottled water, which must provide the same protection for public health. Drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. Measurable amounts do not necessarily indicate that the water poses a health risk.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally-occurring minerals, in fewer cases, radioactive material and substances resulting from the presence of animals or from human activity.

